

INSTALLATION AND OPERATION MANUAL



Crosswind Side Discharge Heat Pump Pool Heater

Inverter Models
CROSSWIND-50-I through -65-I



NOTICE

SCAN WITH QR EQUIPPED SMART
DEVICE FOR ONLINE MANUAL.



FOR YOUR SAFETY: Do not store or use gasoline or other flammable vapors and liquids or other combustible materials in the vicinity of this or any other appliance. To do so may result in an explosion or fire.

NOTE: The instructions in this manual are for the use of qualified individuals specially trained and experienced in the installation and maintenance of this type of equipment and related system components. Installation and service personnel are required by some states to be licensed. Persons not qualified shall not attempt to install, service, or maintain this equipment.

This manual should be maintained in legible condition and kept adjacent to the heat pump pool heater or in a safe place for future use.

Effective: 05-30-25
Replaces: 11-01-24
P/N 241827 Rev. 06

ATTENTION: Please Take This Opportunity to Quickly Register Your Unit

While your unit is being installed by your professional and licensed installer of choice, please take this opportunity to quickly register your unit. With the necessary information in hand, registering your new heat pump pool heater only takes a few moments and is the best way to ensure efficient warranty support during the warranty time frame.

See **Figure 1** at the bottom of the page to locate and record your model and serial number. Once you have done this, please make sure you also have the following information on hand:

- Name, phone number, and email address of homeowner.
- Physical address of where the unit is installed; please include any 'subdivision' or similar information.
- Any service challenges present at the house/neighborhood: gated community, locked access at house, guard dog, etc.
- Date of installation of the new unit.
- Name and phone number of the professional and licensed entity that performed the installation for you.

With all of the above information in hand, please contact us and ask to register your brand new heat pump,

(800)-260-2758 M-F 8:30 - 4:30 EST

or do this online at:


<http://warranty.raypak.com>

You will be given a Warranty Registration Confirmation number which you should notate and keep in an easily remembered accessible location along with your Installation and Operation Manual, a copy of your warranty (provided with your manual) and the above information.

This would also be a good time to review both the manual and the warranty so that you are aware of how to correctly operate your new equipment as well as how to keep from voiding any aspects of your warranty. During the life of your unit, please feel free to use the phone number on the last page below to contact us with any questions you may have about operation, warranty, and/or service.

Thank you very much choosing us to satisfy your pool heating needs.

Warranty Registration Confirmation #:

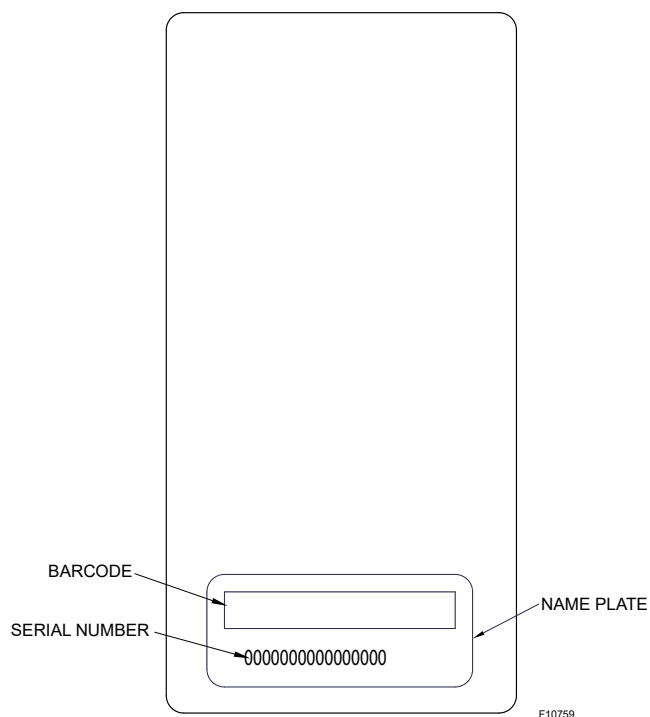

For location of this label on your unit, see **Figure 6**

Figure 1. Model and Serial Number Information

TABLE OF CONTENTS

1. WARNINGS	4	7. OPERATING INSTRUCTIONS.....	17
Pay Attention to These Terms	4	Start-Up Procedures	17
General Precautions	5	Before Start-Up	17
2. WATER CHEMISTRY	5	Starting.....	17
3. BEFORE INSTALLATION.....	6	After Start-Up	17
Installation Considerations	6	Maintenance.....	17
Installation Requirements.....	7	Cold Weather Operation	17
Components for Inverter Models.....	9	Testing.....	18
Specifications and Dimensions	10	Time Clock Override Operation.....	18
Water Connections.....	11	Basic Lead Multiple HPPH Operation	19
4. ELECTRICAL WIRING.....	13	8. TROUBLESHOOTING	20
Wiring	13	Fault Codes.....	20
Electrical Connections.....	13	9. TECHNICAL PARAMETERS	21
Automation Control	13	10. REPLACEMENT PARTS	22
5. WIRING DIAGRAMS	14	11. ILLUSTRATED PARTS LIST.....	23
Crosswind-50-I	14		
Crosswind-65-I	15		
6. CONTROLS.....	16		

THIS INSTALLATION MANUAL MAY NOT BE THE LATEST REVISION PRINTED AT THE TIME OF PRODUCT SHIPMENT. VISIT THE RAYPAK WEBSITE TO VERIFY THE MANUAL DELIVERED WITH YOUR RAYPAK UNIT IS THE MOST UP-TO-DATE VERSION.

1. WARNINGS

Pay Attention to These Terms

▲ DANGER	Indicates the presence of immediate hazards which will cause severe personal injury, death or substantial property damage if ignored.
▲ WARNING	Indicates the presence of hazards or unsafe practices which could cause severe personal injury, death or substantial property damage if ignored.
▲ CAUTION	Indicates the presence of hazards or unsafe practices which could cause minor personal injury or product or property damage if ignored.
CAUTION	CAUTION used without the warning alert symbol indicates a potentially hazardous condition which could cause minor personal injury or product or property damage if ignored.
NOTE	Indicates special instructions on installation, operation, or maintenance which are important but not related to personal injury hazards.

▲ CAUTION: Elevated water temperature can be hazardous. The U.S. Consumer Product Safety Commission has these guidelines:

1. Spa water temperatures should never exceed 104°F (40°C). A temperature of 100°F (38°C) is considered safe for a healthy adult. Special caution is suggested for young children.
2. Drinking of alcoholic beverages before or during spa or hot tub use can cause drowsiness which could lead to unconsciousness and subsequently result in drowning.
3. Pregnant Women Beware! Soaking in water over 102°F (39°C) can cause fetal damage during the first three months of pregnancy resulting in the birth of a brain-damaged or deformed child.
4. Before entering the spa or hot tub, users should check the water temperature with an accurate thermometer; spa or hot tub thermostats may err in regulating water temperatures by as much as 4°F (2.2°C).
5. Persons with a medical history of heart disease, circulatory problems, diabetes, or blood pressure problems should obtain a physician's advice before using pools or hot tubs.
6. Persons taking medications which induce drowsiness, such as tranquilizers, antihistamines, or anticoagulants, should not use spas or hot tubs.

▲ CAUTION: Please do not place hands into the outlet of the pool heater, and do not remove the heater fan screen at any time.

▲ CAUTION: Improper chemical content in a swimming pool or spa can damage the heater. **DO NOT** add pool/spa chemicals to the pool/spa via the skimmer or any other apparatus (feeder, chlorinator, etc.) That is on the influent side (i.e. inflow side) of the heater. This will damage the heater, and such damage is not covered under warranty. **ALWAYS** follow the product manufacturer's directions when adding any chemicals to your pool.

▲ CAUTION: These heat pump pool heaters are charged with R-410A refrigerant. Ensure that all service work is done with gauges and equipment suitable for R-410A.

▲ WARNING: This heat pump is an electromechanical machine that incorporates a pressurized refrigerant gas in a sealed system. **ONLY** trained and qualified service personnel are authorized to install or service this equipment. Without proper training and knowledge of such equipment, any attempt to install or service the unit could result in serious injury or even death.

General Precautions

Attention

1. Follow the instructions to set a comfortable water temperature and avoid overheating.
2. Please don't stack anything near the heat pump that can block air flow to the inlet or exhaust area, or the efficiency of the heater will be reduced and/or stopped. For unit clearance information, see **Figure 2**.
3. Please do not put hands into the outlet of the heater, and do not remove the screen of the fan at any time.
4. If there are abnormal conditions such as noise, smell, smoke, or electrical leakage, please switch off the heater immediately and contact the local dealer. Don't try to repair it yourself.
5. Do not use or stock combustible gas or liquid such as thinners, paint and fuel close the heater in order to avoid fire.
6. The piping between the pool and the heater should be less than 30 ft (9.1 m) long, or heater performance may suffer.

Safety

1. Please keep the main power supply switch far away from children.
2. If a power outage happens while the heater is running, the heater will restart automatically when power is restored. Please switch off the power supply when there is a power outage, and reset the temperature when power is restored.
3. Please switch off the main power supply in the event of lightning and stormy weather to prevent machine damage from a lightning strike.
4. If the heater is stopped for a long time, please cut off the power supply and drain water completely from the heater by opening the union of the inlet pipe.

Special Attention

Please read this instruction manual carefully and operate strictly according to the user manual before starting the heat pump, otherwise the heat pump may be damaged or cause you unnecessary harm.

This product is only for heating swimming pool or spa water, and cannot be used for other applications.

Inlet and outlet water nozzles are not designed to bear the weight of external pipes. Support the piping independently.

Make sure power is turned off before opening the case and performing service work.

1. The heater must be installed by a qualified electrician.
2. Set heating temperature within the recommended range to maximize comfort.
3. Keep the air inlet and exhaust free from obstructions.
4. This heater has a power-off memory function.
5. When the ambient temperature is at or below 32°F (0°C) make sure the main power switch is turned off and all water is drained from the heat exchanger.
6. Never place your hand or any other object into the air inlet or exhaust of the heater.
7. If you see, hear, smell or otherwise sense anything unusual (such as abnormal noise, smell, smoke, or electrical leakage) switch off the main power switch immediately and contact your local dealer installer.
8. Do not attempt to repair the heater yourself.

2. WATER CHEMISTRY

NOTE: Corrosive water causes damages which will not be covered under warranty.

Chemical imbalance can cause severe damage to your heater and associated equipment. Maintain your water chemistry according to **Table A**. If the mineral content and dissolved solids in the water become too high, scale forms inside the heat exchanger tubes, reducing heater efficiency and damaging the heater. If the pH drops below 7.2, this will cause corrosion of the heat exchanger and severely damage the heater. **Heat exchanger damage resulting from corrosive water will not be covered by the warranty.**

For your health and the protection of your pool equipment, it is essential that your water be chemically balanced. The following levels must be used as a guide for balanced water.

⚠ CAUTION: Free chlorine must not exceed 5 ppm which can damage the heater and is not covered under warranty.

- Occasional chemical shock dosing of the pool or spa water should not damage the heater providing the water is balanced.
- Automatic chemical dosing devices and salt chlorinators are usually more efficient in heated water. Unless controlled, they can lead to excessively high chlorine levels which can damage your heater.
- Further advice should be obtained from your pool or spa builder, accredited pool shop, or chemical supplier for the correct levels needed for your pool.

Automatic Chlorinators and Chemical Feeders

All chemicals must be introduced and completely diluted in the pool or spa water before being circulated through the heater. Do not place sanitizing chemicals in the skimmer. High chemical concentrations will result when the pump is not running (e.g. overnight).

Chlorinators must feed downstream of the heater and have an anti-siphoning device to prevent chemical backup into the heater when the pump is shut off.

See plumbing diagrams starting with **Figure 7**.

NOTE: High chemical concentrates from feeders and chlorinators that are out of adjustment will cause rapid corrosion to heat exchanger. Such damage is not covered under the warranty.

Recommended Level(s)	Fiberglass Pools	Fiberglass Spas	Other Pool and Spa Types
Water Temperature	68-88°F (20-31°C)	89-104°F (31-40°C)	68-104°F (20-40°C)
pH	7.3-7.4	7.3-7.4	7.6-7.8
Total Alkalinity (ppm)	120-150	120-150	80-120
Calcium Hardness (ppm)	200-300	150-200	200-400
Salt (ppm)	4500 Maximum	4500 Maximum	4500 Maximum
Free Chlorine (ppm)*	2-3	2-3	2-3
Total Dissolved Solids (ppm)	3000 Maximum**	3000 Maximum**	3000 Maximum**

*Free Chlorine **MUST NOT EXCEED 5 ppm!**
**In saltwater chlorinated pools, the total TDS can be as high as 6000 ppm.

Table A. Pool Water Chemistry

3. BEFORE INSTALLATION

⚠ WARNING: This heat pump is an electromechanical machine that incorporates a pressurized refrigerant gas in a sealed system. ONLY trained and qualified service personnel are authorized to install or service this equipment. Without proper training and knowledge of such equipment, any attempt to install or service the unit could result in serious injury or even death.

This manual contains important information on the use, maintenance and troubleshooting of your new heater. This unit must be properly installed, maintained and operated for optimal performance.

This heater is an extremely efficient, economical machine designed specifically for pool heating. It is similar in design and operation to a typical residential air conditioning system. The unit employs a hermetic motor/compressor operating in a refrigeration cycle to extract heat from ambient air and deliver it to the circulating pool water.

All heat pump pool heaters have a lower BTU/hr heating capacity than a gas-fired or oil-fired heater for the same pool and will have to operate more hours per day to keep the pool at setpoint. It may operate up to 24 hours a day at certain times. It is designed to do so. Even with long runtime hours, it will heat the pool at less cost than other heaters using fossil fuel.

Since evaporation is the main cause of heat loss from a pool, keeping the pool covered whenever it is not in use will greatly reduce the cost of keeping the pool heated. Even during warmer weather, Raypak recommends keeping the pool covered at night.

INSTALLATION

Installation Considerations

Locate the heater carefully to minimize installation costs while providing maximum efficiency of operation, and to allow adequate service access, as follows:

For unrestricted air intake and service access, position each side of the unit according to **Figure 2**.

⚠ WARNING: This unit is designed for outdoor installation. It is NOT certified for indoor installation. DO NOT install it in an enclosed area such as a shed or garage, or under a porch or deck.

To minimize water piping, locate the unit as close as possible to the existing pool pump and filter.

Irrigation water should be directed away from the heater as irrigation water spray can damage the heater.

Rain water runoff - the unit is designed to operate outdoors and can be exposed to rain. However, rain water run off falling directly onto the unit can cause damage and/or shorten the life of your unit. Such damage is not covered under warranty. Install rain gutters or rain diverters on your roof if the unit is installed in a position where contact with rain runoff may occur.

⚠ WARNING: Do not install the unit within 3 ft (0.9 m) of fossil-fuel-burning heaters. Air intake along the sides of this heater could disturb the combustion process of the unit, and could cause damage or personal injury. Mount the unit on a level, sturdy base, preferably a concrete slab. The size of the base should be at least 3 ft by 3 ft (0.9 m x 0.9 m).

Installation Requirements

The heater must be installed by a pool professional. End users are not qualified to install the heater. Damage may occur to the heater or threaten the safety of the user.

1. The heater must be installed OUTSIDE in a well ventilated area to avoid air recirculation, and in a place with adequate room for both installation and maintenance. Please refer to the following illustration.
2. This unit requires a minimum of 12" (305 mm) of clearance from walls, shrubbery, equipment, etc. around the entire perimeter of the heater. This allows for ample air intake. Ample clearance around the air outlet is required to prevent recirculation of air. We recommend not placing the unit underneath eaves, decks, or porches, as this causes recirculation of discharged air, thereby reducing the efficiency of the heater, or even stopping it.
3. Do not stack anything that will block air flow near the inlet or outlet areas, or have any barrier within 20" (508 mm) behind the main heater, or the efficiency of the heater will be reduced.
4. The heater needs a pool pump (to be supplied by the user). For recommended pump flow rates, see **Table H**.
5. When the heater is running, there will be condensation water discharged at the base. Place the drainage nozzle into the condensation outlet and attach it securely, then contact a drainage pipe from it to the drain.
6. The piping between pool and the heater should be less than 30 ft (9.1 m), or heater performance cannot be ensured.
7. For best results, insulate the pipes between the pool and heater.
8. It is important to keep the area next to the heater clear of shrubs, bushes and chemical containers. These could prevent air from circulating fully through the heater, and will affect the operation of the heater or damage the heater.
9. When installed in areas where freezing temperatures can be encountered, drain the water circuit to prevent possible freeze-up damage. See page 17 for Cold Weather Operation procedures.
10. If the heater is below the water line of the pool, an external Water Flow Switch might be needed.

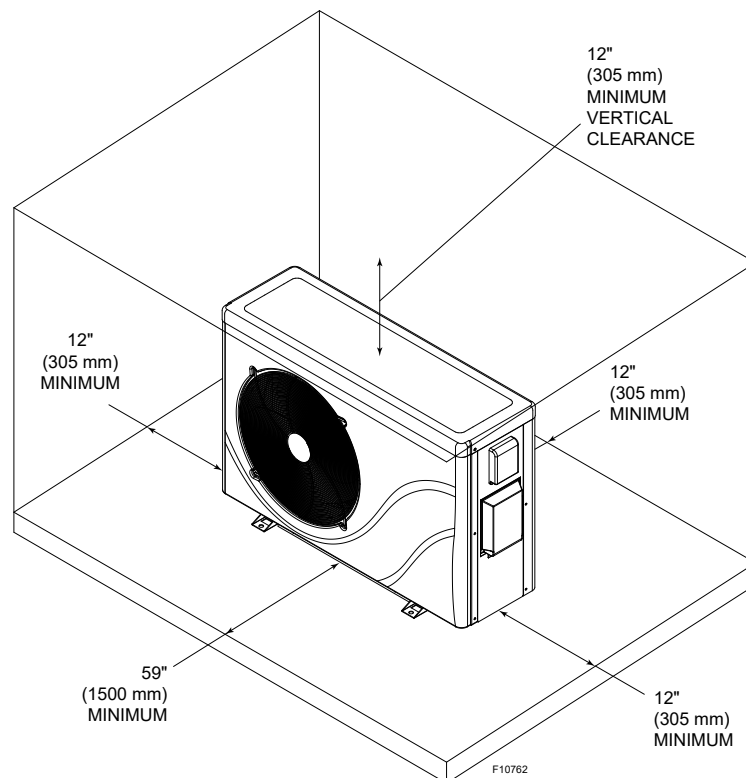


Figure 2. Ventilation Clearances

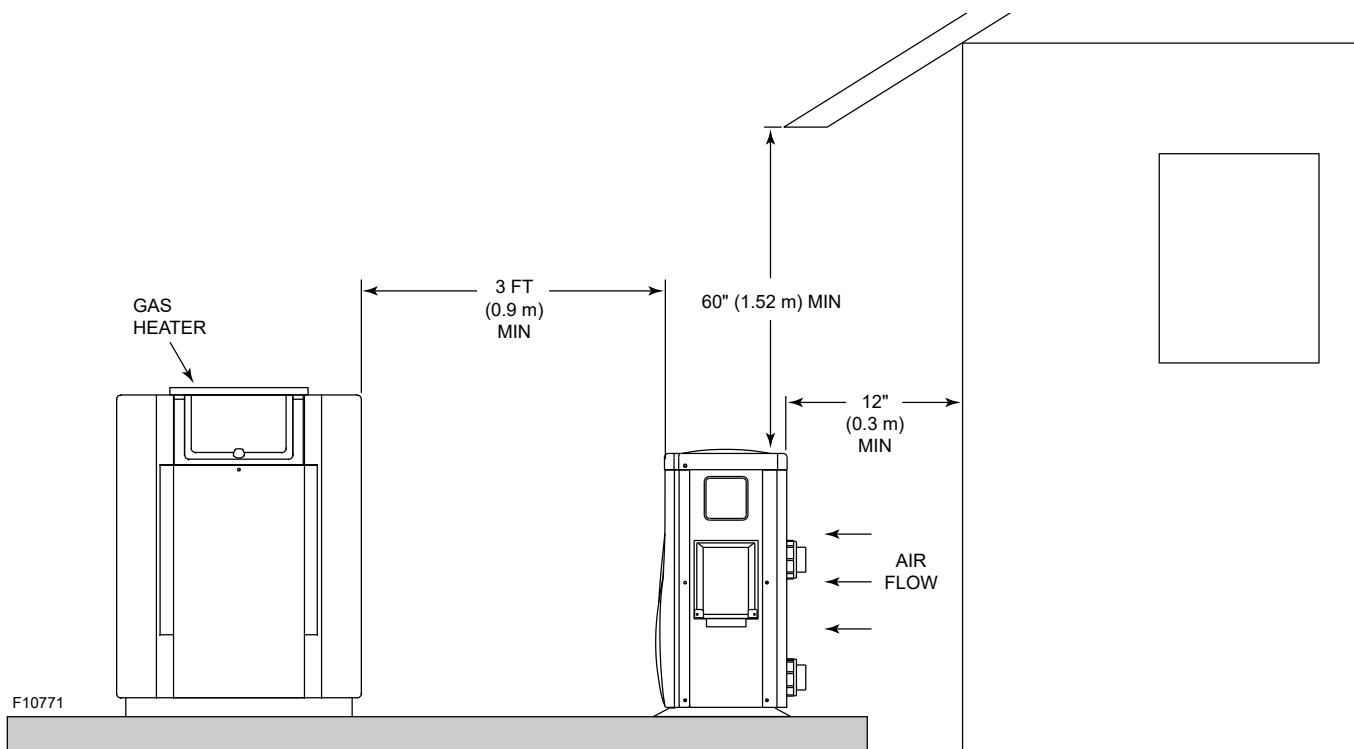


Figure 3. Installation Clearances

Inverter Models 60Hz (Heating and Cooling)			
Models	Raypak P/N	Rheem P/N	RUUD P/N
CROSSWIND-50-I	017740	017744	017748
CROSSWIND-65-I	017741	017745	017749

Table B. Model Identification

Components for Inverter Models

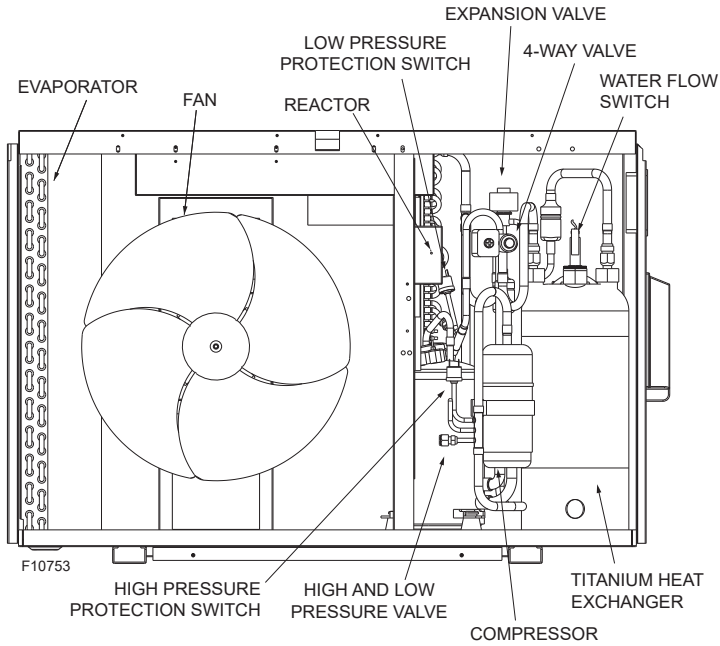


Figure 4. Inverter Model - Component Locations, Front View

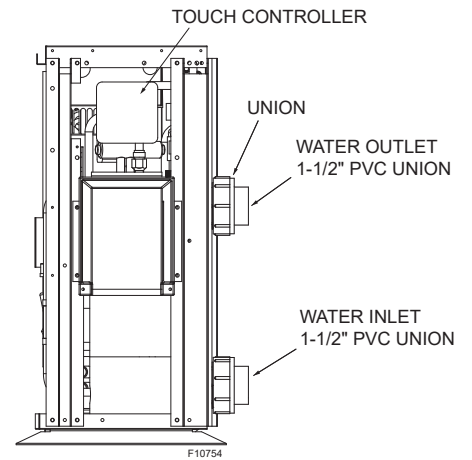


Figure 5. Inverter Model - Component Locations, Right Side View

Specifications and Dimensions

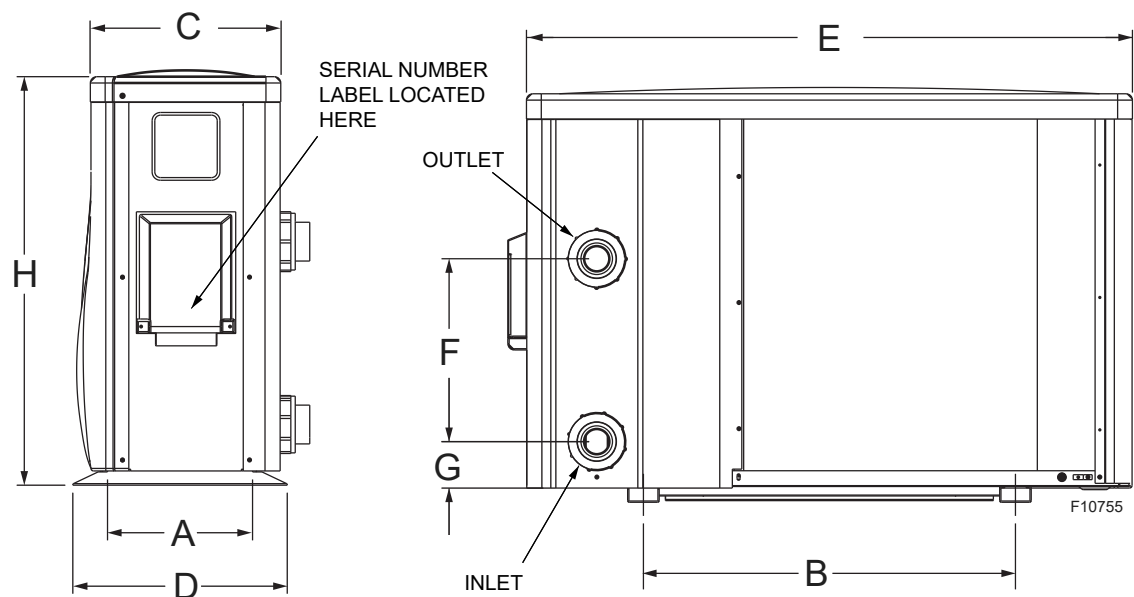


Figure 6. Dimensions

Inverter Models									
Models	A	B	C	D (Width)	E (Length)	F	G	H (Height)	Weight lb. (kg)
CROSSWIND-50-I	12.4 (315)	23.2 (312)	12.3 (312)	13.4 (340)	39 (991)	13 (330)	2.9 (74)	25.9 (657)	115 (52)
CROSSWIND-65-I	15.6 (395)	23.2 (312)	15.4 (390)	16.5 (420)	39 (991)	14.2 (360)	2.9 (74)	25.9 (657)	137 (62)

Table C. Basic Product Data - in. (mm)

Water Connections

NOTE: Unions Lock-Rings and O-rings are connected to the Inlet and Outlet of the Heat Exchanger.

CAUTION: The heater Inlet and Outlet connections are NOT interchangeable. They must be connected as instructed below in Figure 7.

WARNING: Chemical feeders can result in serious damage to, or premature failure of the heater and may void the heater warranty. Install a check valve and/or a Hartford loop AFTER the heater and BEFORE any chlorinating devices. Install any automatic chemical feeders AFTER the heater.

1. Connect the heater in the return water line between the filter and the pool/spa. See the piping layout shown in **Figure 7**.
2. Connect the filter outlet to the fitting marked at the bottom front of the unit.
3. Connect the fitting marked to the return piping to the pool/spa. The inlet/outlet connection fittings of the unit are 1-1/2 inch PVC unions.

Water connections from the heater to the main return line can be PVC pipe or flexible pipe approved for the purpose and, in either case, should be at least equal in size to the main pool/spa circulation piping.

1. Shutoff diverter valves, preferably three-way valves which allows for a bypass route, on the inlet and outlet lines of the heater are required:
 - a. to protect (completely bypass) the heater from any harmful chemical treatments (i.e. acid wash, back-to-back super chlorinators, stain treatments, etc.); or
 - b. to isolate the heater for service/repair or freeze preparation and still allow pool/spa circulation to continue.

Install any automatic chemical feeders downstream of the heater. See the piping layout shown in **Figure 7**.

Note that some municipalities do not allow the use of a shutoff valve on the effluent/outlet side of any heating equipment, especially when there is one on the inlet side. These entities typically instead allow a PVC tee and spring check valve on the effluent/outlet side. This is acceptable and can also double as your protection from chemical feeders and chlorinators that are downstream of the unit.

Operate the pump and check the system for leaks. For more information regarding Water Pressure Drops Specification, see **Table I on page 22**.


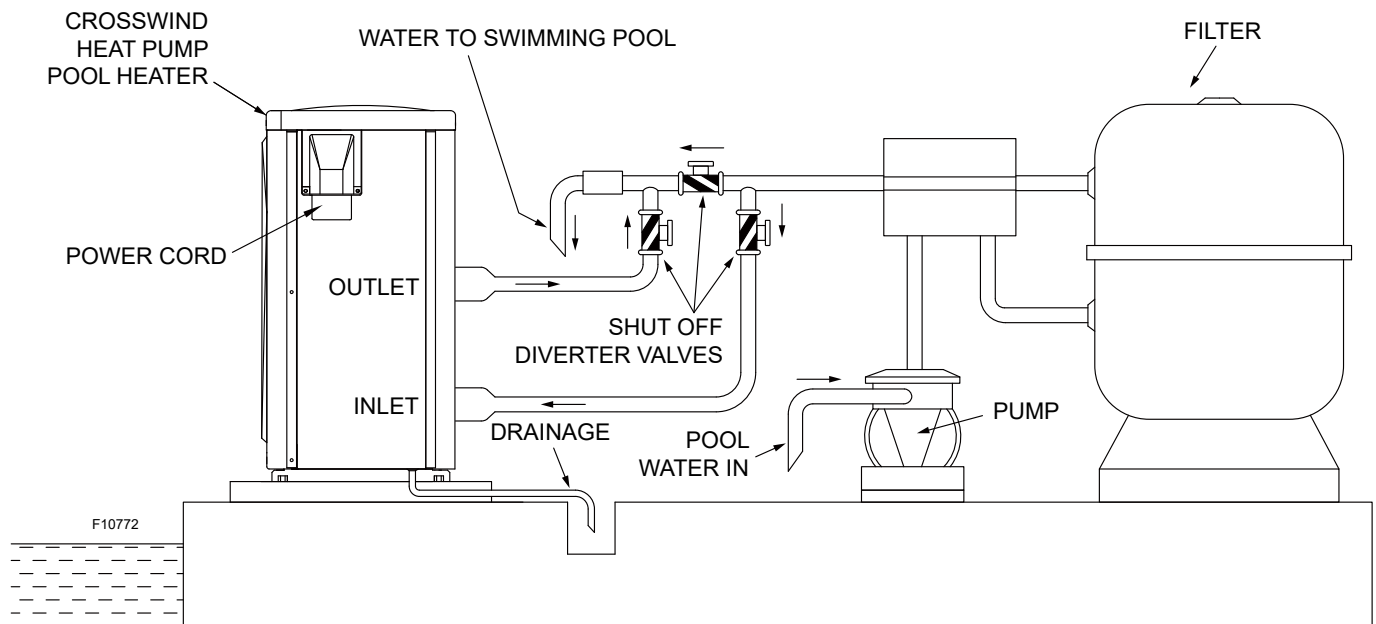


Figure 7. Piping Layout

RAYPAK, INC.

WIND LOAD EVALUATION OF HEAT PUMP CROSSWIND MODELS: AT GRADE MOUNTED APPLICATIONS

APPROVED DESIGN CRITERIA: 50.2 PSF LATERAL
41.2 PSF UPLIFT
WIND LOAD

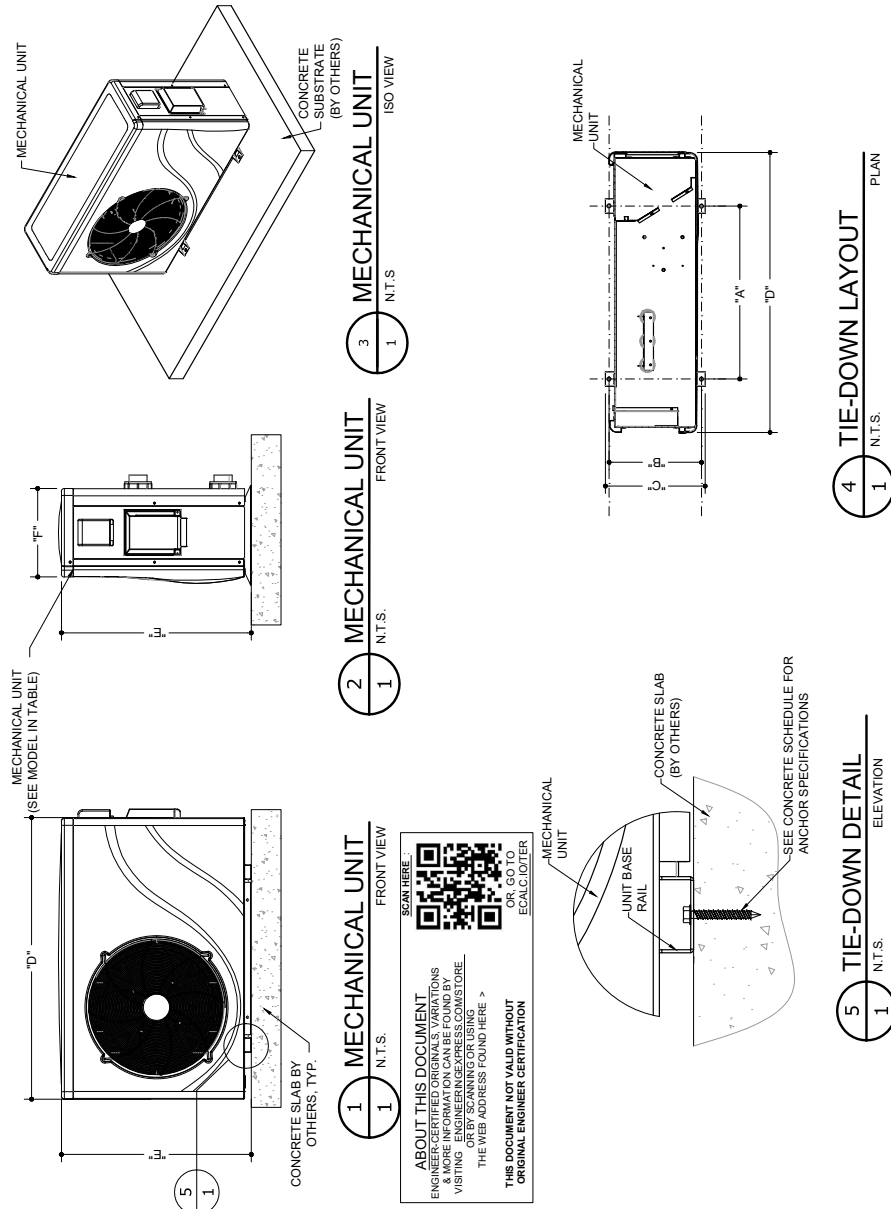

See "Table C. Basic Product Data - in. (mm)" on page 10 for dimensions and weights.

Figure 8. Hurricane Tie Down Instructions

4. ELECTRICAL WIRING

Wiring

Electrical installation should be performed by a licensed electrician only.

1. Make sure the power supply is at the rated voltage of the appliance.
2. Ground the heater.
3. Wiring must be installed by a professional installation technician and follow the circuit diagram.

Electrical Connections

Electrical installation should be done by a licensed electrician only.

Refer to the unit rating plate below the control panel for precise power requirements for your unit, and for ampacity and over-current protection requirements.

All wiring must be in accordance with the National Electrical Code, NFPA No. 70, latest edition, and all applicable state and local codes. The wiring diagrams are located on **page 14** through **page 15**.

⚠ WARNING: This heater **MUST** be installed using flexible conduit for supply wiring to the unit. This will allow movement of the conduit whenever the junction box is removed for service.

Locate the equipment disconnect means within 3 ft. (0.9 m) of the heater's electrical enclosure, or as close to the heater as possible. Always satisfy applicable codes and standards.

In sizing power wiring, be especially aware of up-sizing requirements necessary due to wiring distances. Always satisfy applicable codes and standards.

NOTE: Refer to the National Electrical Code, Article 680, for general requirements for swimming pools and equipment, and to Article 440 for special considerations necessary for circuits supplying hermetic refrigeration motor/compressors.

This heater is pre-wired to work with external control systems, heat-on-demand options, and other external time clock overrides. Refer to the external control system's instructions.

NOTE: Please refer to page 18 for instructions on the Time Clock Override. Page 19 details the instructions on operating multiple Heat Pumps with a Lead Unit to control follower units.

Models	Power	Min. Circuit Ampacity	Breaker Size (Amp)	
			min.	max.
CROSSWIND-50-I	208-230VAC 60HZ/1PH	16A	20A	20A
CROSSWIND-65-I		20A	20A	25A

* Reference only - see National Electrical Code or local codes for wire gauge length limits.

Table D. Electrical Power Requirements

Automation Control

2-Wire System - Heat Only

The Crosswind inverter models have a temperature sensor for temperature automation control.

Heater 2-Wire Controllers (Heat Only).

1. Install wires from the automation controller for "Heat" on the terminal strip inside the heater electrical compartment on the side of the heater.
2. Remove the jumper wire on the terminal block from terminals marked #5 and #6. See **Figure 9**, and wiring diagrams on **page 14** through **page 15**.

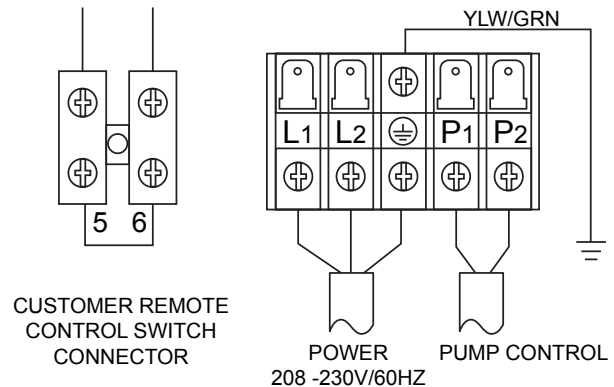



Figure 9. Automation Control 2-Wire System Connection

3. Install the automation control wires for "Heat" to terminals #5 and #6. See **Figure 9**.
4. Set temperature setting on the heater to 104°F (40°C).

NOTE: When the automation controller has a HEAT command the unit will be in the HEAT mode. When the automation controller does not have a HEAT command the unit will be in the OFF mode.


5. WIRING DIAGRAMS

Crosswind-50-I

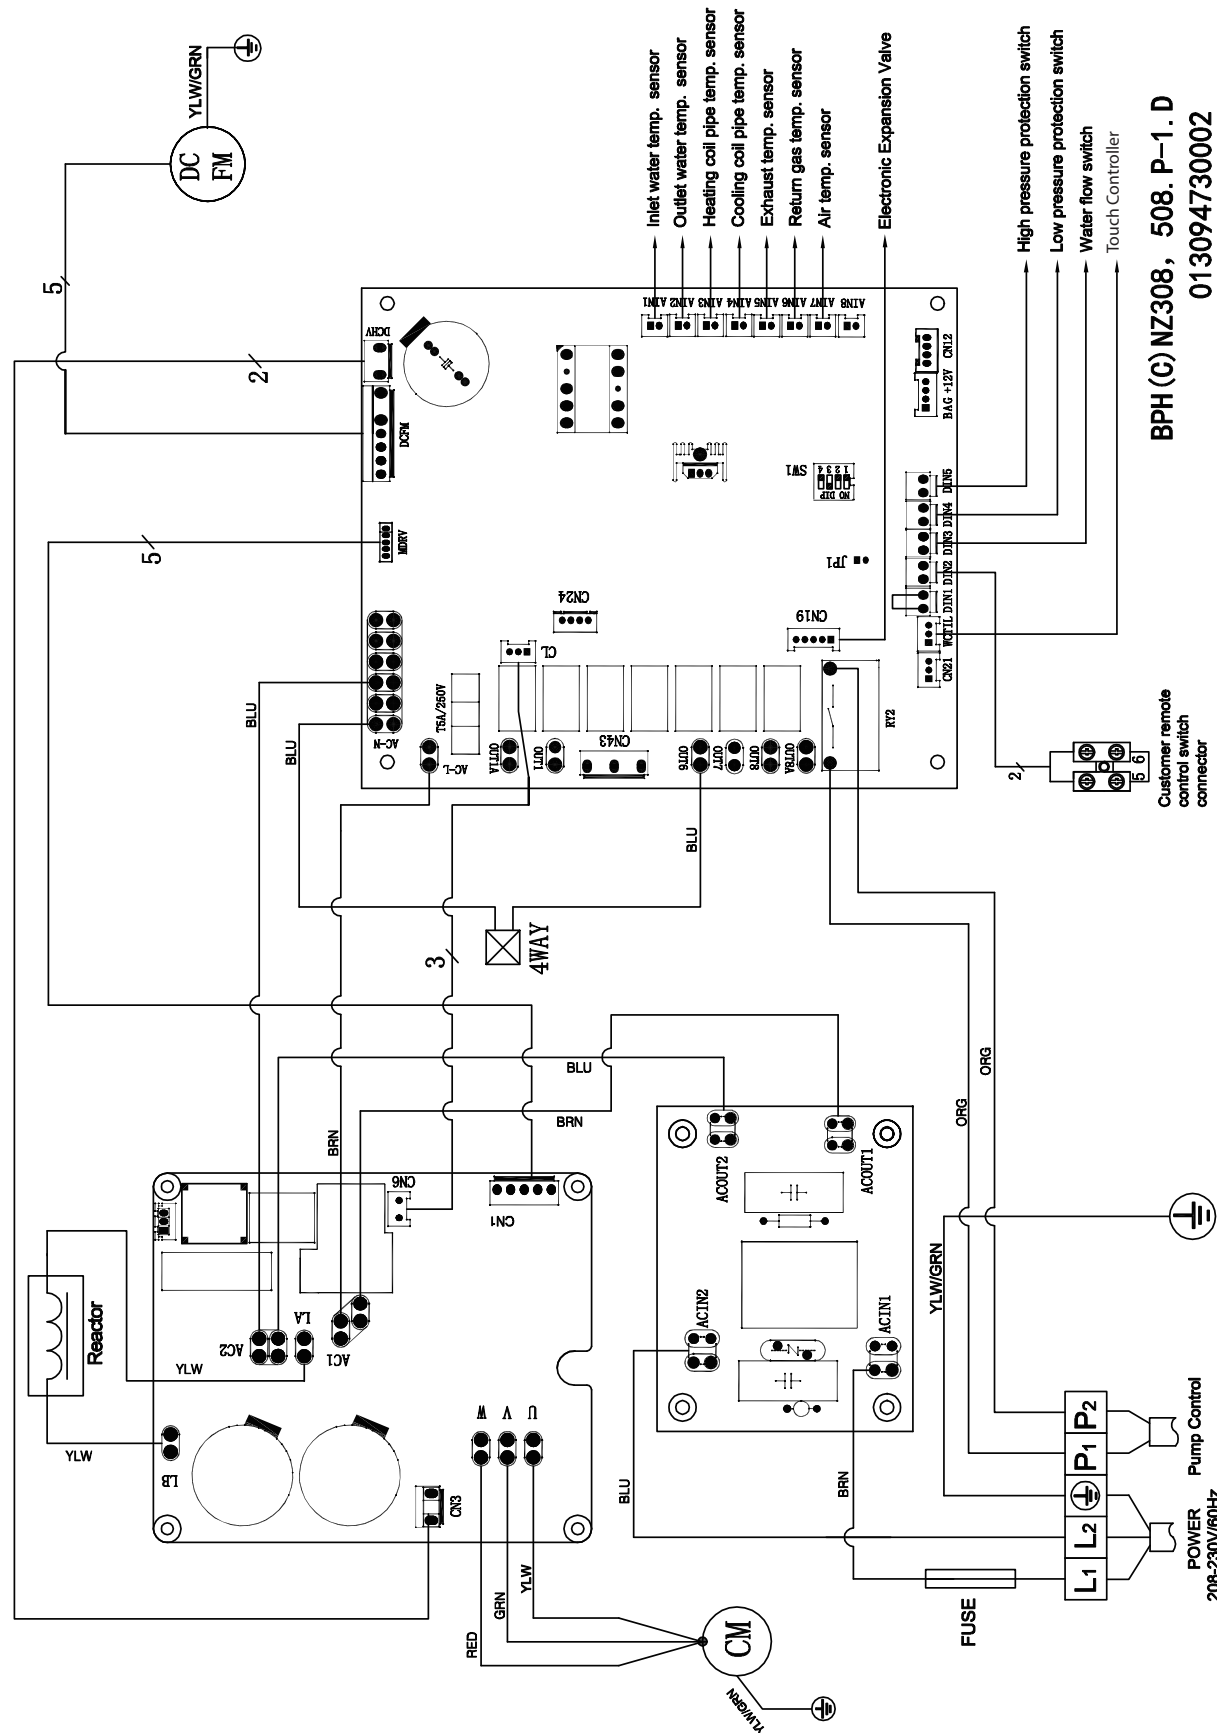

BPH (C) NZ308, 508. P-1. D
013094730002

Crosswind-65-I

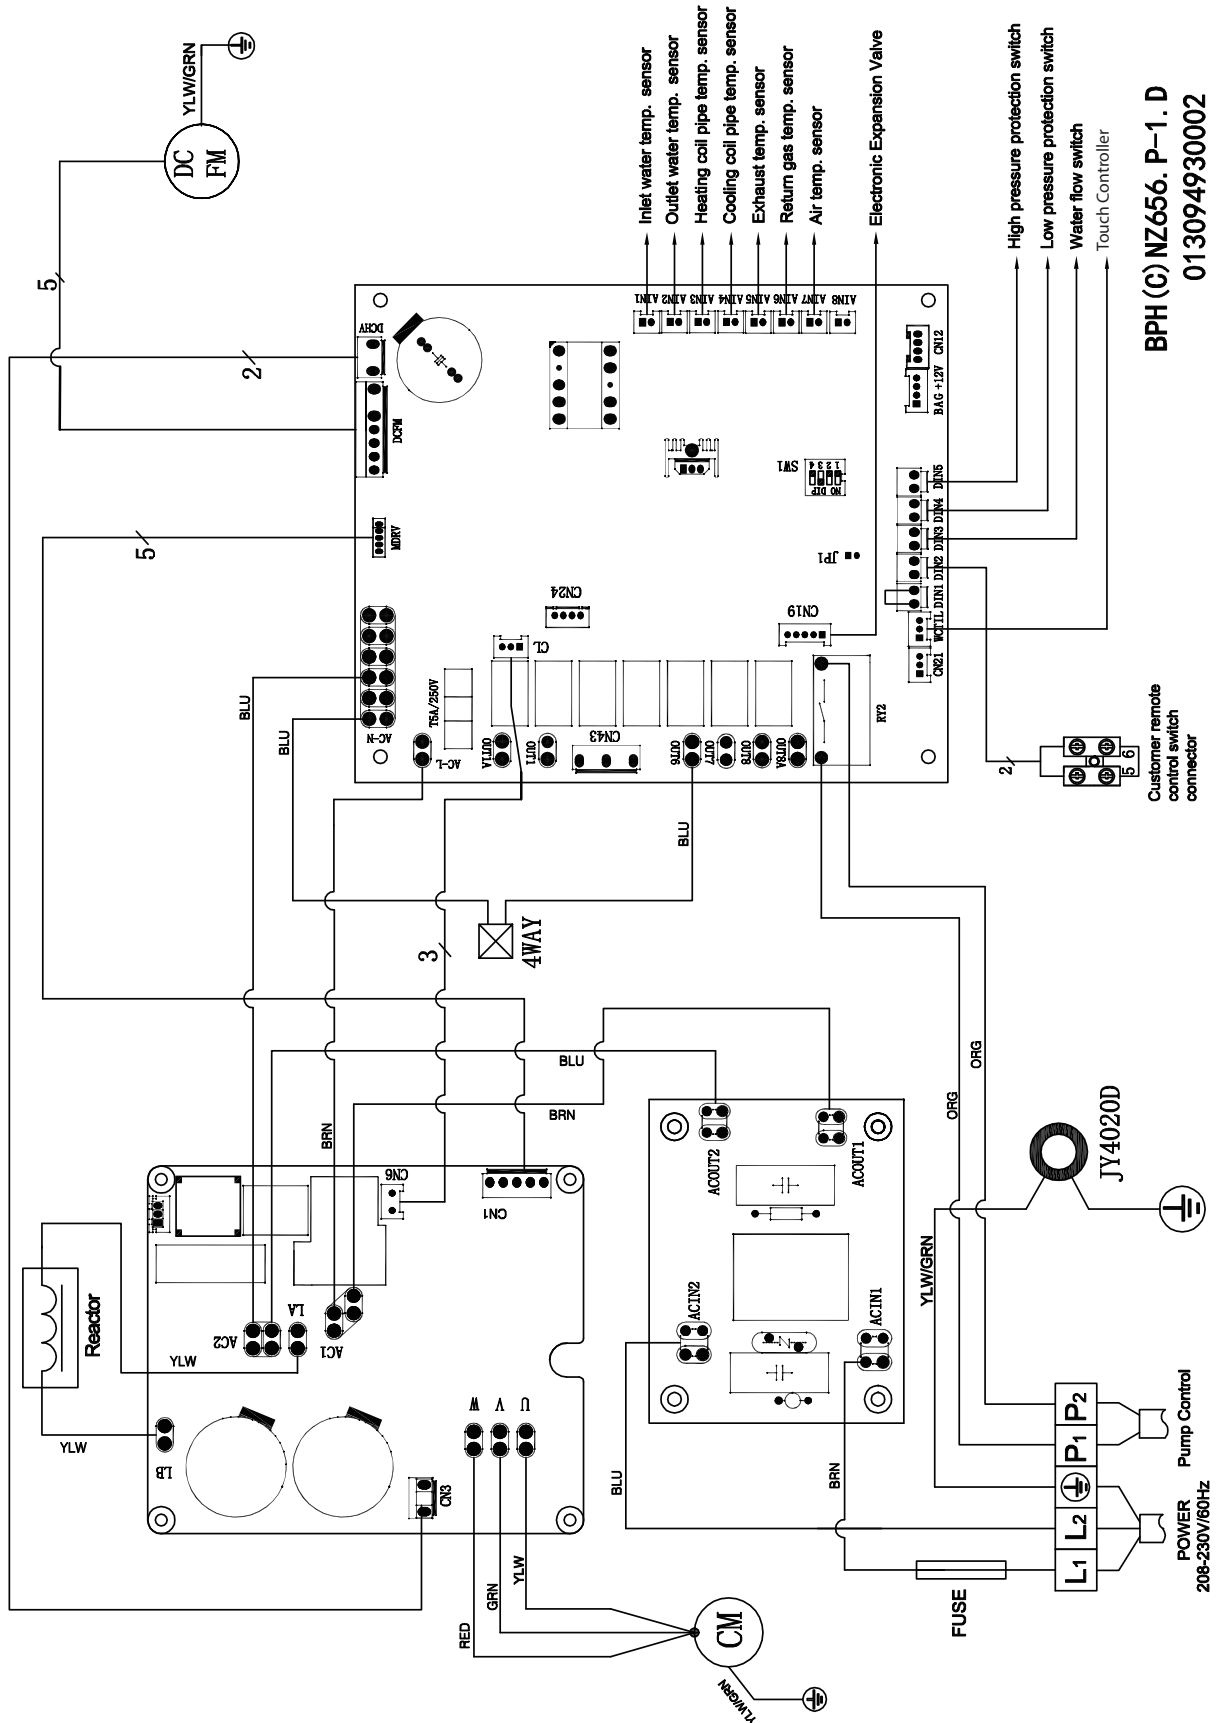

BPH (C) NZ656. P-1. D
013094930002

6. CONTROLS

Inverter Models

The Display controls general operation. The layout, main functions and buttons are shown below.

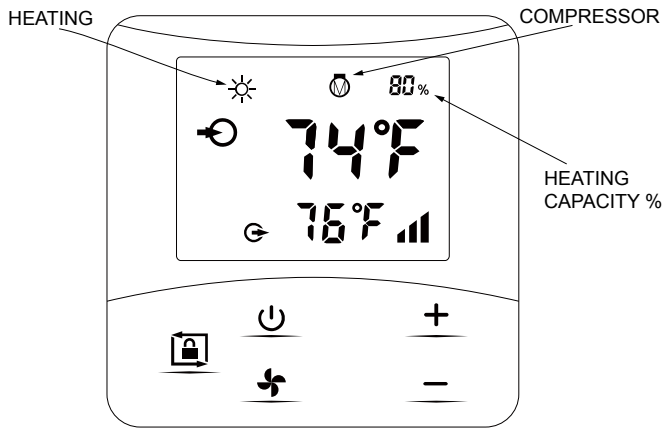


Figure 10. Operation Display, Models -50-I through -65-I

Symbol	Designation	Button Functions
		Press 3-seconds to unlock/lock screen
	ON/OFF	Power On/Off
	Speed	Smart/Silent Mode
	Up	Temperature Adjustment
	Down	Temperature Adjustment

Table E. Display Button Functions

Power On

Press the LOCK button for 3-seconds to light up screen, then press POWER to power on the heater.

Adjust/Set Temperature:

When screen is unlocked, press UP or DOWN to display or adjust the set temperature.

To change from Fahrenheit to Celsius, press the and the for 3-seconds. Min. setting 64°F (18°C). Max. setting 104°F (40°C).

Smart/Silent mode selection

Smart mode, as default, will be activated when the HEAT PUMP is on, and the screen shows .

Press FAN to enter Silent Mode (80% max.). The display screen will show .

NOTE: Select Smart Mode for initial heating.

Screen Lock

If no button is used within 30-seconds, the screen will lock automatically. At this point the back-light will turn off and 0% will display.

Alternatively you can lock the display by pressing the LOCK button for 3-seconds to achieve the same result.

To unlock the screen and use any other button, follow the **Power On** instructions in Section 6.

Defrosting

Auto Defrosting:

- When the heater is defrosting, HEATING will continually flash.
- After defrosting, HEATING will stop flashing.

Manual Defrosting:

- When heater is heating, press FAN and MINUS together for 5-seconds to start manual defrosting, will flash continuously.

After defrosting, HEATING will stop flashing.

NOTE: Manual defrosting intervals should be more than 30-minutes and the compressor should run for more than 10-minutes.

Heat, Cool or Auto Mode

- Press the Lock button for 3-seconds to light the screen.
- Press the Lock button to change the operating MODE.

MODES:

- POOL HEAT (sun icon) Heat to SET POINT
- POOL COOL (snow icon) Cool to SET POINT
- POOL AUTO (triangle icon) Heat or Cool to SET POINT.

7. OPERATING INSTRUCTIONS

Start-Up Procedures

If your heater has been installed correctly, operating the heater is an easy task. The display allows you to turn the heater ON or OFF and adjust the temperature settings for the pool or spa. The temperature range is factory-set from 64°F (18°C) to 104°F (40°C) - HEAT ONLY. 54°F (12°C) to 86°F (30°C) - COOL ONLY.

Before Start-Up

Model Identification

The model number of the heater can be found on the rating plate. See **Figure 1**.

Water

Water must be flowing through the heater during operation. Ensure that the system is filled with water and that the pump is operating.

⚠ WARNING: Operation of the heater without water circulation will cause rapid and severe damage to the heater, and will void the warranty.

Starting

NOTE: The user **MUST** start the pool pump before the heater, and turn off the heater before the pool pump, or the heater will be damaged.

The user should start the pool pump, and check for any leakage of water; Power on and press the ON/OFF button on the heater, and set a suitable temperature at the thermostat.

In order to protect the heater, the heater is equipped with a time-delay starting function. When starting the heater, the blower will run for 1-minute before the compressor.

After the heater starts up, check for any abnormal noise from the heater.

After Start-Up

Feel the inlet and outlet pipes. The outlet pipe should be only slightly warmer than the inlet. It should not be hot.

Model Identification

The model number of the heater can be found on the name plate. See **Figure 1**.

Maintenance

⚠ CAUTION: Turn off heater power supply before service work including cleaning, examination, or repair. Do not touch any electronic components until the LED indication lights on the PCB are off.

When a power outage happens while the heater is running, the heater will restart automatically when the power is restored. Please switch off the power supply when there is a power outage, and reset the temperature setting when power is restored.

If the heater is stopped for a long time, please cut off the power supply and drain water completely from the heater by opening the union of the inlet pipe.

Check bolts, cables, and connections regularly for looseness and adjust as needed.

Cold Weather Operation

In the 'off' season, when the pool is not going to be used at all:

1. Cut off the power supply to avoid damage to the heater.
2. Drain water from the heater by removing the piping connection on both the inlet and outlet side, from the pool to the heater. As needed, use a shop dry/wet vac or air pressure to purge any excess water.
3. Unscrew the water union of the outlet pipe (top) to let water flow out completely from the inlet (bottom). See **Figure 11**.

⚠ CAUTION: If water is left in the system during freezing weather, the titanium heat exchanger may be damaged.

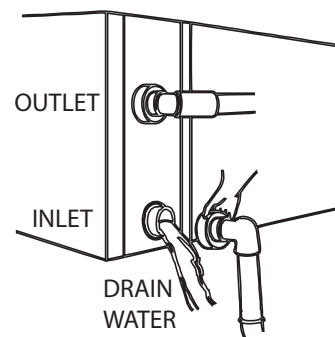


Figure 11. Inlet and Outlet Connections

4. Cover the heater when not in use to protect it from the weather.
5. Clean the heater exterior with standard household detergent or clean water. Never use gasoline, paint thinner or other flammable liquids.

Testing

Inspection before use:

1. Check installation of the entire heater and pipe connections according to the pipe connecting drawing (**Figure 7**).
2. Check the electric wiring according to the electric wiring diagram; and grounding connection on **page 14** through **page 15**.
3. Make sure that the main heater power switch is OFF.
4. Check the temperature setting.
5. Check the air inlet and outlet.

Time Clock Override Operation/ Time Clock Extender Operation

Advanced application (a professional technician shall perform this operation only) - Turns pool pump ON, sets time to check for a heat demand operation.

1. Press the **LOCK** pad and **HOLD** (3-seconds) to light up the screen.
2. Press **FAN** & the **+** pad together for 5-seconds.
3. The CODE "PO" with the value of "0" will be visible on the display. (**NOTE:** these steps must be done in 3-seconds or a restart in the programming is required).
4. Press the **FAN** pad to enter the modification code-press the **+** pad to change the code to "2".

Modification code 2 – Time/water temperature control through terminals **P1 & P2** (the value of the code will be flashing) (Time setting **ONLY** available when the **PO** is set to a value of "2". Adjust the range: 10 - 120-min.

5. Press the **FAN** pad to confirm and quit the modification code.
6. Press the **+** pad to the next modification code "**P1**".
7. Press the **FAN** pad – then press the **+** or **-** to change the time range – **DEFAULT** is set to 60-min. (**NOTE:** the value of the code will be flashing).
8. 60-minutes is the recommended setting, or you can change to a higher value (ex. 61 - 120-minutes).
9. Press the **FAN** pad to confirm and quit the modification code.
10. Press the **POWER** pad to exit the modification code.

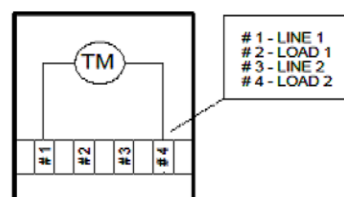


Figure 12. Simple Time Clock Line Loads

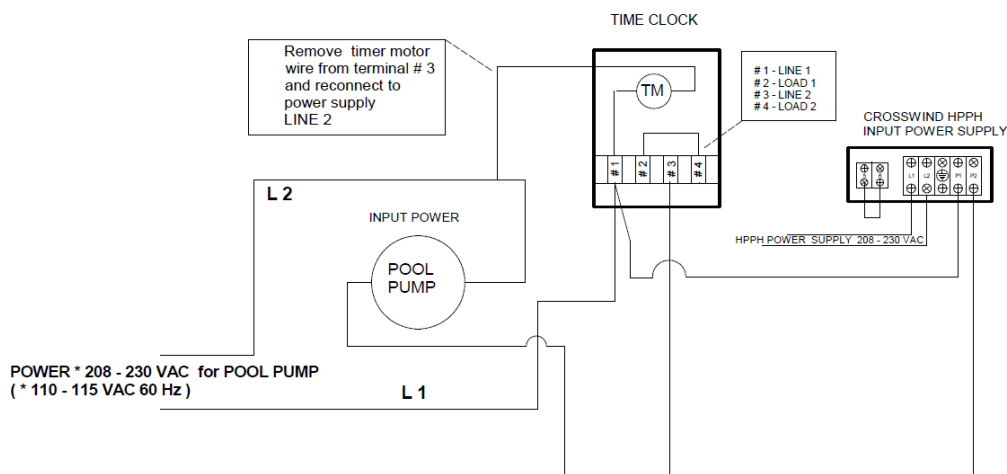


Figure 13. Time Clock Override/Extender Operation Diagram

Basic Lead Multiple HPPH Operation

FOR THE OPERATION OF RUNNING MULTIPLE HPPH with a LEAD HPPH to control the follower HPPH:

The program on the **LEAD HPPH & Followers** needs to be changed for the operation of the single **HPPH** to control the followers **HPPH**.

1. Press and **HOLD** (3-seconds) the **LOCK** pad to light up the screen.
2. Press **FAN** and the **+** pad together for 5-seconds.
3. The **CODE "PO"** with the value of "0" will be evident on the LCD display. (**NOTE:** these steps must be performed in 3-seconds, or a restart in the programing is required).
4. Press the **FAN** pad to enter the modification code - press the **+** pad to change the code to "1". (The value of the code will be flashing. The modification code 1 – water temperature control through terminals P1 & P2). See **Figure 14**.
5. Press the **FAN** pad to confirm and quit the modification code.
6. Press the **POWER** pad to exit.
7. The **FOLLOWERS HPPH** needs to have the water setpoint adjusted to 104°F (40°C):
 - a. Press and **HOLD** (3-seconds) the **LOCK** pad to light up the screen.
 - b. With the screen "unlocked" press the **+** pad to raise the setpoint to 104°F (40°C).

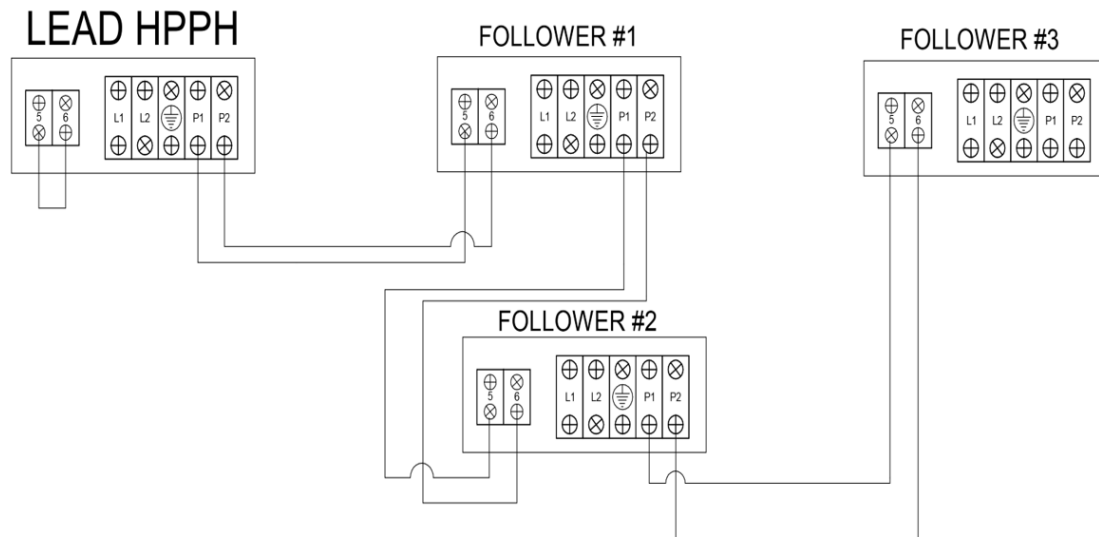


Figure 14. Lead Multiple HPPH Wiring

8. TROUBLESHOOTING

If these solutions below do not work, contact your dealer.

Do not attempt to repair the heater yourself.

Failure	Reason	Solution
Heat Pump Does Not Run	Main power off	Wait for the power to be restored
	Power switch is off	Turn on switch
	Fuse burnt	Replace fuse
	Circuit breaker tripped	Turn circuit breaker back on
Heat Pump Runs but Does Not Heat	Air inlet blocked	Remove obstructions
	Air outlet blocked	Remove obstructions
	3-minute protection	Please wait more than 3-minutes for warming to start
	Temp set too low	Set temperature setting

Table F. Common Faults

NOTE: All units in this manual are single-phase. See **Electrical Power Requirements** in Table D.

No.	Display	Non-Failure Description
1	E3	No water protection
2	E5	Power supply exceeds operation range
3	E6	Excessive temp difference between inlet and outlet water (insufficient water flow protection)
4	Eb	Ambient temperature too high or too low protection
5	Ed	Anti-freezing reminder
No.	Display	Failure Description
1	E1	High pressure protection
2	E2	Low pressure protection
3	E7	Water outlet temp too high or too low protection
4	E8	High exhaust temp protection
5	EA	Evaporator overheat protection (only at cooling mode)
6	P0	Controller communication failure
7	P1	Water inlet temp sensor failure
8	P2	Water outlet temp sensor failure
9	P3	Gas exhaust temp sensor failure
10	P4	Evaporator coil pipe temp sensor failure (6 flashes)
11	P5	Gas return temp sensor failure
12	P6	Cooling coil pipe temp sensor failure (17 flashes)
13	P7	Ambient temp sensor failure (3 flashes)
14	P8	Cooling plate sensor failure
15	P9	Current sensor failure
16	PA	Restart memory failure
17	F1	Compressor drive module failure (14 flashes)
18	F2	PFC module failure
19	F3	Compressor start failure / no water
20	F4	Compressor running failure
21	F5	Inverter board over current protection
22	F6	Inverter board overheat protection
23	F7	Current protection
24	F8	Cooling plate overheat protection
25	F9	Fan motor failure
26	Fb	Power filter plate no-power protection
27	FA	PFC module over current protection

Table G. Fault Codes

9. TECHNICAL PARAMETERS

NOTE: Technical parameters as published in AHRI directory.

Parameter	Crosswind Models	
	50-I	65-I
Performance Condition: Air 80°F (27°C), Water 80°F (27°C), Humidity 80%		
Heating capacity (BTUH)	44,750	61,000
Heating capacity (BTUH) in silent mode	35,000	42,000
Coefficient of Performance	6.1	5.74
Performance Condition: Air 80°F (27°C), Water 80°F (27°C), Humidity 63%		
Heating capacity (BTUH)	42,500	57,650
Heating capacity (BTUH) in silent mode	33,300	40,000
Coefficient of Performance	5.8	5.3
Performance Condition: Air 50°F (10°C), Water 80°F (27°C), Humidity 63%		
Heating capacity (BTUH)	21,000	24,500
Heating capacity (BTUH) in silent mode	21,000	24,500
Coefficient of Performance	4.16	4.10
Performance Condition: Air 95°F (35°C), Water 80°F (27°C), Humidity 63%		
Cooling capacity (BTUH)	20,000	22,000
Coefficient of Performance	2.7	3.2
Rated input power (kW)	1.28	1.55
Rated input current (A)	5.6	6.8
Power supply	208-230VAC/ 1 Ph/60Hz	
Refrigerant (R410A) in oz.	38.8	45.9
Water flow GPM (L/min)	21.9~30.6 (83~116)	28.5~37.5 (108~142)
Sound pressure 39" (3 m) dBA	34.9~45.0	38.2~49.3
Heat exchanger	Titanium in PVC	
Casing	ABS casing	
Air discharge	Horizontal	
Water pipe in-out Spec	1-1/2" PVC (50 mm)	
Net Dimension	See Table C on page 10.	
Net Weight		

* The values indicated are valid under ideal conditions: Pool is well covered, filtration system running at least 15-hours a day.

Table H. Technical Parameters

Flow GPM (LPM)	Pressure Drop (in. WC)	
	50-I Models	65-I Models
10 (37.8)	4.43	3.60
20 (75.7)	11.36	10.25
30 (113.5)	23.00	21.89
40 (151.4)	38.24	40.18

Table I. Pressure Drop Values

10. REPLACEMENT PARTS

NOTE: To supply you with the correct part, it is important that you supply the heater model number, serial number and type of gas when applicable.


Any part returned for replacement under standard company warranties must be properly tagged with a return parts tag, completely filled in with the heater serial number, model number, etc., and shipped to the Company freight prepaid. If determined defective by the Company and within warranty, a like part or equal substitution will be returned, freight collect. Credit will not be issued.

MANUFACTURER:

Raypak, Inc.
2151 Eastman Avenue
Oxnard, CA 93030

1-800-260-2758

11. ILLUSTRATED PARTS LIST

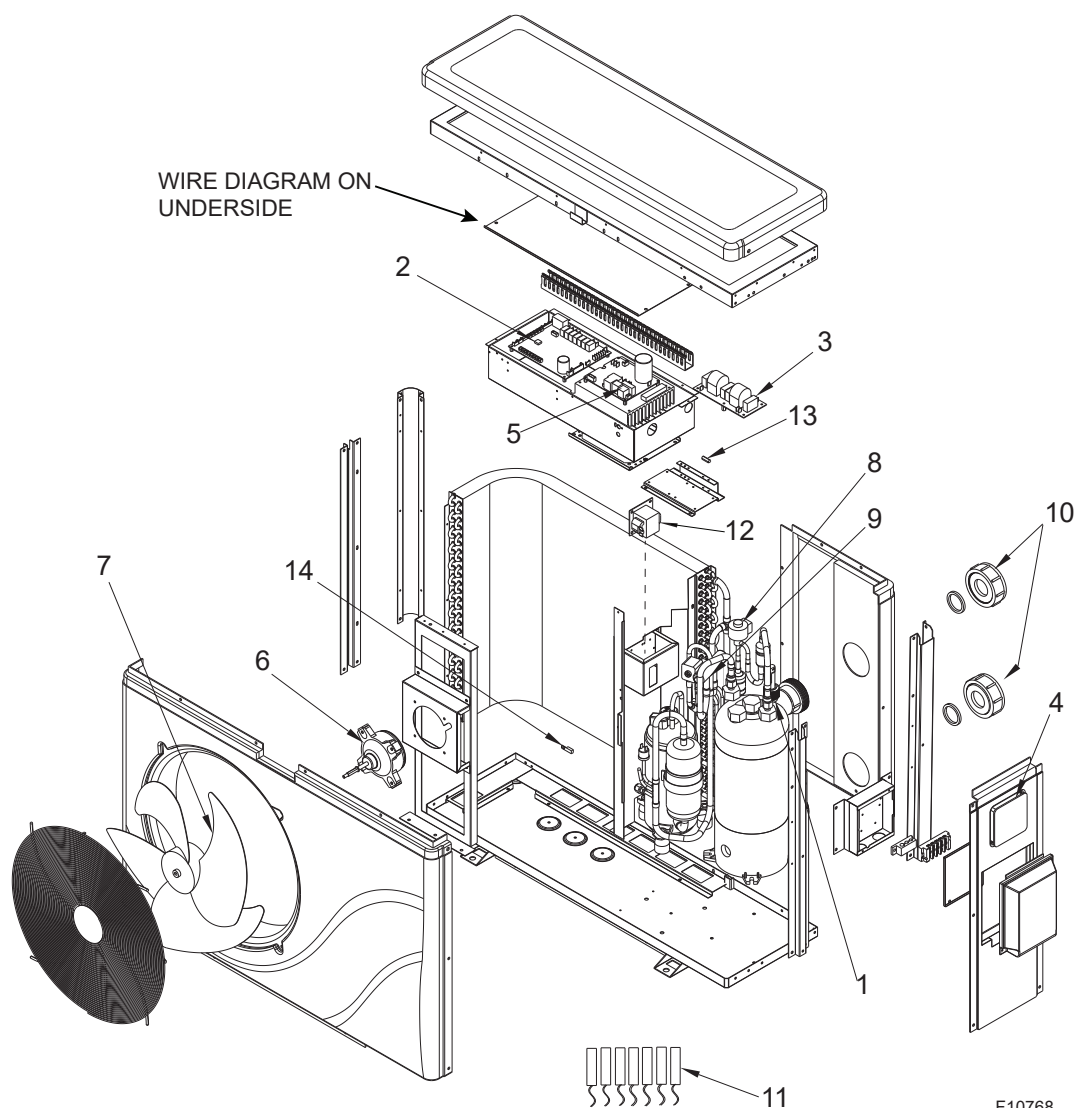

Item	Description	Crosswind-50-1	Crosswind-65-1	*Instructions P/N
1	Water Flow Switch	018146F	018146F	241808
2	PC Board	018179F	018180F	241809
3	Power Filter Plate	018148F	018148F	241810
4	Touch Controller	018149F	018149F	241811
5	Inverter Board	018352F	018150F	241812
6	Fan Motor	018151F	018151F	241 813
7	Fan Blade	018152F	018152F	241814
8	Electronic Expansion Valve Coil	018153F	018153F	241815
9	4-Way Valve Coil	018154F	018161F	241816
10	Water Unions And O-Rings	018155F	018155F	241817
11	Full Set Of Sensors	018157F	018157F	241819
12	Precision Inductor	018158F	018162F	241820
13	Fuse	018163F	018164F	241821
14	Drain Kit	018160F	018160F	241822

*The instructions listed above can all be found on the Raypak website in digital format.

Revision 06 reflects the following changes:

Removed all references to "On/Off" (-50-O & -65-O) models. Added "number of flashes" details, a note that all units are single-phase and "no water" to No. 20 failure description to Table I. Added "Wire Diagram on Underside" to IPL exploded view.